


## 110-kV-Abspannmast, Mastgrundtyp A63 (WA +0,0)

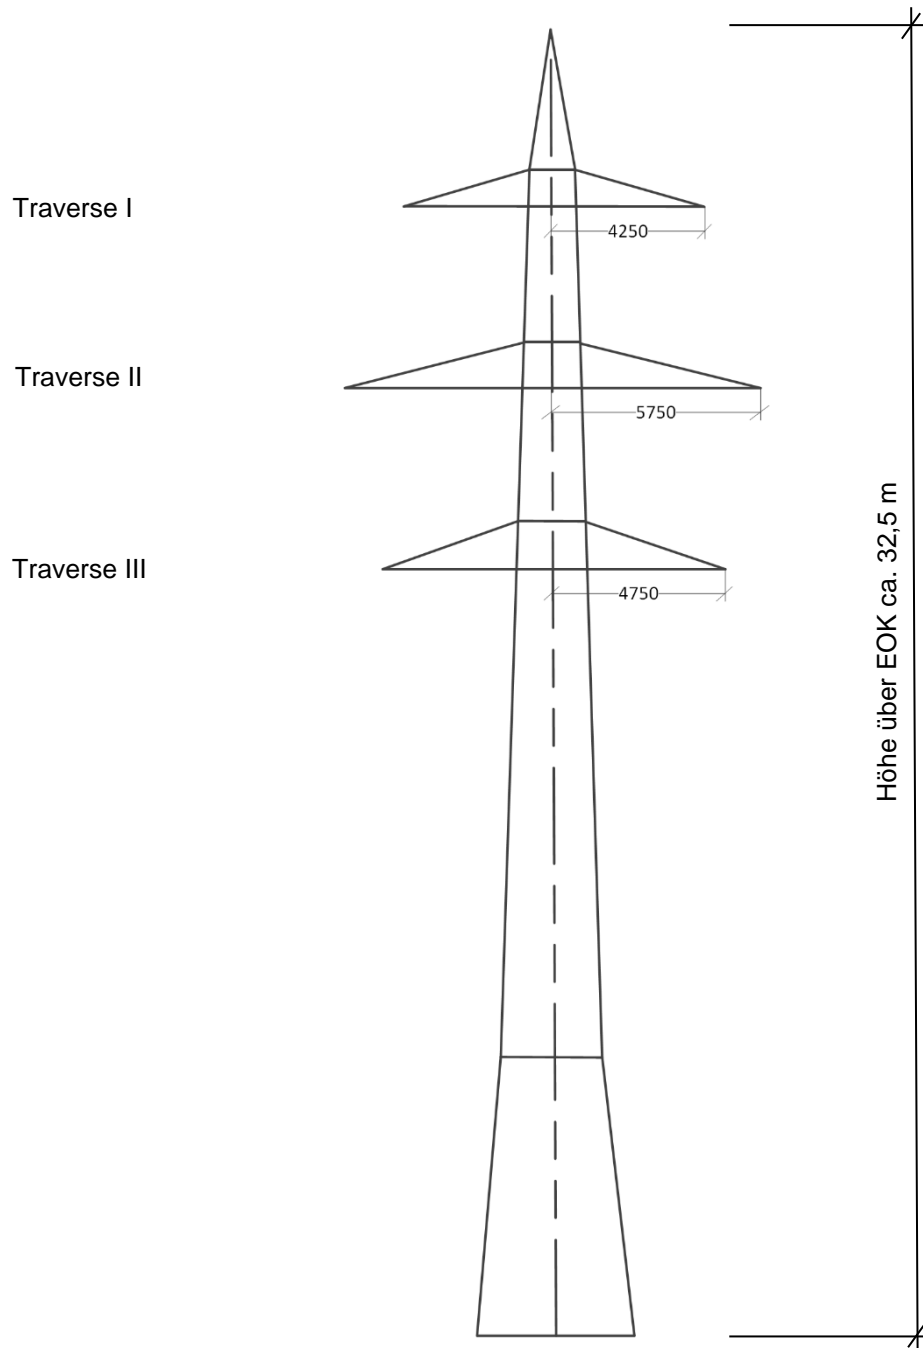

Winkelgruppe		Traverse I	Traverse II	Traverse III
WA1	180° - 160°	4,25	5,75	4,75
WA2/WA2WE	180° - 140°	4,50	6,00	5,00
WA3	140° - 120°	5,25	6,75	5,75
WA4/WA4WE	120°/140° - 100°	5,75	7,25	6,25